


**NOTES:**

- FIRE ALARM SYSTEMS SHALL HAVE PERMANENTLY INSTALLED AUDIBLE AND VISIBLE ALARMS COMPLYING WITH NFPA 72 (1999 OR 2002 EDITION) EXCEPT THAT THE MAXIMUM ALLOWABLE SOUND LEVEL OF AUDIBLE NOTIFICATION APPLIANCES COMPLYING WITH SECTION 4-3.2.1 OF NFPA 72 (1999 EDITION) SHALL HAVE A SOUND LEVEL NO MORE THAN 115 DB(A) AT THE MINIMUM HEARING DISTANCE FROM THE AUDIBLE APPLIANCE.
- WHERE BOTH VISUAL AND TACTILE CHARACTERS ARE REQUIRED, WHETHER ON SIGN WITH BOTH VISUAL AND TACTILE CHARACTERS, OR TWO SEPARATE SIGNS, ONE WITH VISUAL, AND ONE WITH TACTILE CHARACTERS, SHALL BE PROVIDED.
- RAISED CHARACTERS SHALL BE 1/32 INCH MINIMUM ABOVE THEIR BACKGROUND.
- CHARACTERS BETWEEN THE BASELINES IF SEPARATE LINES OF RAISED CHARACTERS SHALL NOT BE ITALIC, OBLIQUE, SCRIP, HIGHLY DECORATIVE OR OF OTHER UNUSUAL FORMS.
- CHARACTERS SHALL BE SELECTED FROM FONTS WHERE THE WIDTH OF THE UPPERCASE LETTER "O" IS 55 PERCENT MINIMUM AND 110 PERCENT MAXIMUM OF THE HEIGHT OF THE UPPERCASE LETTER "I".
- CHARACTER HEIGHT MEASURED VERTICALLY FROM THE BASELINE OF THE CHARACTER SHALL BE 5/8 INCH MINIMUM AND 2 INCHES MAXIMUM BASED ON THE HEIGHT OF THE UPPERCASE LETTER "T". EXCEPTION: WHERE SEPARATE RAISED AND VISUAL CHARACTERS WITH THE SAME INFORMATION ARE PROVIDED, RAISED CHARACTER HEIGHT SHALL BE PERMITTED TO BE 1/2 INCH MINIMUM.
- STROKE THICKNESS OF THE UPPERCASE LETTER "I" SHALL BE 15 PERCENT MAXIMUM OF THE HEIGHT OF THE CHARACTER.
- CHARACTER SPACING SHALL BE MEASURED BETWEEN THE TWO CLOSEST POINTS OF ADJACENT RAISED CHARACTERS WITHIN A MESSAGE, EXCLUDING WORD SPACES, WHERE CHARACTERS HAVE RECTANGULAR CROSS SECTIONS. SPACING BETWEEN INDIVIDUAL RAISED CHARACTERS SHALL NOT BE ITALIC, OBLIQUE, SCRIP, HIGHLY DECORATIVE OR OF OTHER UNUSUAL FORMS. STROKE WIDTH MAXIMUM, WHERE CHARACTERS HAVE OTHER CROSS SECTIONS, SPACING BETWEEN INDIVIDUAL RAISED CHARACTERS SHALL BE 1/16 INCH MINIMUM AND 4 TIMES THE RAISED CHARACTER STROKE WIDTH MAXIMUM AT THE BASE OF THE CROSS SECTIONS, AND 1/8 INCH MINIMUM AND 4 TIMES THE RAISED CHARACTER STROKE WIDTH MAXIMUM AT THE TOP OF THE CROSS SECTIONS. CHARACTERS SHALL BE SEPARATED FROM RAISED BORDERS AND DECORATIVE ELEMENTS 3/8" MINIMUM.
- SPACING BETWEEN THE BASELINES OF SEPARATE LINES OF RAISED CHARACTERS WITHIN A MESSAGE SHALL BE 135 PERCENT MINIMUM AND 170 PERCENT MAXIMUM OF THE RAISED CHARACTER HEIGHT. TEXT SHALL BE IN A HORIZONTAL FORMAT.
- BRAILLE SHALL BE CONTRACTED (GRADE 2).
- BRAILLE DOTS SHALL HAVE A DOMED OR ROUNDED SHAPE AND SHALL COMPLY WITH TABLE 703.3.1. THE INDICATION OF AN UPPERCASE LETTER OR LETTERS SHALL ONLY BE USED BEFORE THE FIRST WORK OF SENTENCES, PROPER NOUNS AND NAMES, INDIVIDUAL LETTERS OF THE ALPHABET, INITIALS, AND ACRONYMS.
- BRAILLE SHALL BE POSITIONED BELOW THE CORRESPONDING TEXT IN A HORIZONTAL FORMAT, FLUSH LEFT OR CENTERED, IF TEXT IS MULTI-LINED, BRAILLE SHALL BE PLACED BELOW THE ENTIRE TEXT. BRAILLE SHALL BE SEPARATED 3/8 INCH MINIMUM AND 1/2 INCH MAXIMUM, EXCEPTION: BRAILLE PROVIDED ON ELEVATOR CAR CONTROLS SHALL BE SEPARATED 3/16 INCH MINIMUM AND SHALL BE LOCATED EITHER DIRECTLY BELOW OR ADJACENT TO THE CORRESPONDING RAISED CHARACTERS OR SYMBOLS.
- TACTILE CHARACTERS FOR ELEVATORS SHALL NOT BE REQUIRED TO BE MOUNTED BETWEEN 48 INCHES AND 60 INCHES.
- WHERE A TACTILE SIGN IS PROVIDED AT A DOOR, THE SIGN SHALL BE LOCATED ALONGSIDE THE DOOR AT THE LATCH SIDE. WHERE A TACTILE SIGN IS PROVIDED AT DOUBLE DOORS WITH ONE ACTIVE LEAF, THE SIGN SHALL BE LOCATED ON THE ACTIVE LEAF. WHERE A TACTILE SIGN IS PROVIDED AT DOUBLE DOORS WITH TWO ACTIVE LEAFS, THE SIGN SHALL BE LOCATED TO THE RIGHT OF THE RIGHT HAND DOOR. WHERE THERE IS NO WALL SPACE AT THE LATCH SIDE OF A SINGLE DOOR OR AT THE RIGHT SIDE OF DOUBLE DOORS, SIGN SHALL BE LOCATED ON THE NEAREST ADJACENT WALL. SIGNS CONTAINING TACTILE CHARACTERS SHALL BE LOCATED SO THAT A CLEAR FLOOR SPACE OF 18 INCHES MINIMUM BY 18 INCHES MINIMUM, CENTERED ON THE TACTILE CHARACTERS, IS PROVIDED BEYOND THE ARC OF ANY DOOR SWING BEHIND THE CLOSED DOOR. WHERE THERE IS NO WALL SPACE AT THE LATCH SIDE OF A SINGLE DOOR OR AT THE RIGHT SIDE OF DOUBLE DOORS, SIGN SHALL BE LOCATED ON THE APPROACH SIDE OF THE DOOR AS ONE ENTERS THE ROOM OR SPACE. SIGNS THAT IDENTIFY EXITS SHALL BE LOCATED ON THE APPROACH SIDE OF THE DOOR AS ONE ENTERS THE ROOM OR SPACE. SIGNS THAT IDENTIFY EXITS SHALL BE LOCATED ON THE APPROACH SIDE OF THE DOOR AS ONE ENTERS THE ROOM OR SPACE.
- ACCESSORIES AND THEIR BACKGROUNDS SHALL HAVE A NON-GLARE FINISH. CHARACTERS SHALL CONTRAST WITH THEIR BACKGROUND WITH EITHER LIGHT CHARACTERS ON A DARK BACKGROUND OR DARK CHARACTERS ON A LIGHT BACKGROUND. APPROPRIATE ENFORCEMENT AGENCY MAY APPROVE OTHER COLORS TO COMPLEMENT DECOR OR UNIQUE DESIGN. THE SYMBOL CONTRAST SHALL BE LIGHT ON DARK OR DARK ON LIGHT.
- CHARACTERS SHALL BE UPPERCASE OR LOWERCASE OR A COMBINATION OF BOTH.

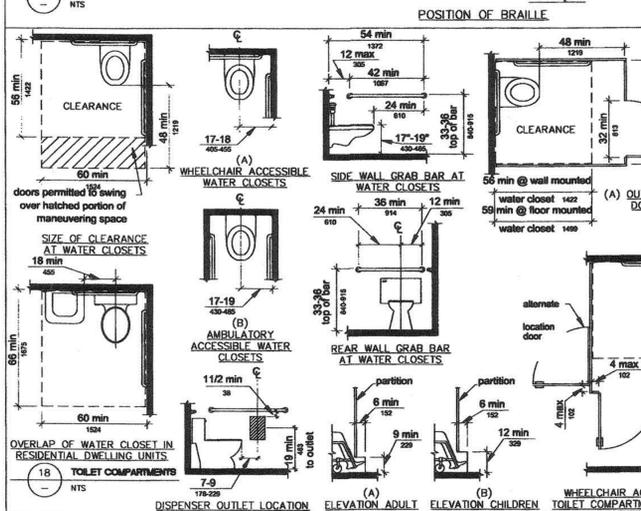

MEASUREMENT RANGE	MINIMUM IN INCHES MAXIMUM IN INCHES	HEIGHT ABOVE FLOOR TO BASE LINE OF CHARACTER	HORIZONTAL VIEWING DISTANCE	MINIMUM CHARACTER HEIGHT
DOT BASE DIAMETER	0.059 (1.5MM) TO 0.063 (1.6MM)	40 INCHES TO LESS THAN OR EQUAL TO 70 INCHES	LESS THAN 6 FEET	5/8 INCH
DISTANCE BETWEEN TWO DOTS IN THE SAME CELL	0.100 (2.5MM)	GREATER THAN 70 INCHES TO LESS THAN OR EQUAL TO 120 INCHES	6 FEET AND GREATER	5/8 INCH, PLUS 1/8 INCH PER FOOT OF VIEWING DISTANCE ABOVE 6 FEET
DISTANCE BETWEEN CORRESPONDING DOTS IN ADJACENT CELLS	0.300(7.6MM)	GREATER THAN 120 INCHES	LESS THAN 15 FEET	2 INCHES
DOT HEIGHT	0.025 (0.6MM) TO 0.037 (0.9MM)		15 FEET AND GREATER	2 INCH, PLUS 1/8 INCH PER FOOT OF VIEWING DISTANCE ABOVE 15 FEET
DISTANCE BETWEEN CORRESPONDING DOTS FROM ONE CELL DIRECTLY BELOW	0.365 (9.2MM) TO 0.400 (10.2MM)		21 FEET AND GREATER	3 INCH, PLUS 1/8 INCH PER FOOT OF VIEWING DISTANCE ABOVE 21 FEET

**NOTES:**

- CLEARANCES, TURNING SPACE SHALL BE PROVIDED WITHIN THE ROOM. REQUIRED CLEAR FLOOR SPACES, CLEARANCE AT FIXTURES, AND TURNING SPACE SHALL BE PERMITTED TO OVERLAP. DOORS SHALL NOT SWING INTO THE CLEAR FLOOR SPACE OR CLEARANCE REQUIRED FOR ANY FIXTURE OTHER THAN THE DOOR TO THE ACCESSIBLE WATER CLOSET COMPARTMENT. A DOOR IN ANY POSITION, MAY ENCRUSH INTO THE TURNING SPACE BY 12 INCHES. EXCEPTION: WHERE THE TOILET ROOM OR BATHING ROOM IS FOR INDIVIDUAL USE AND A COMPLYING CLEAR FLOOR SPACE IS PROVIDED WITHIN THE ROOM BEYOND THE ARC OF THE DOOR SWING, DOORS SHALL BE PERMITTED TO SWING INTO THE CLEAR FLOOR SPACE OR CLEARANCE REQUIRED FOR ANY FIXTURE.
- MIRRORS LOCATED ABOVE LAVATORIES OR COUNTERTOPS SHALL BE INSTALLED WITH THE BOTTOM EDGE OF THE REFLECTING SURFACE 40 INCHES MAXIMUM ABOVE THE FINISH FLOOR OR GROUND. MIRRORS NOT LOCATED ABOVE LAVATORIES OR COUNTERTOPS SHALL BE INSTALLED WITH THE BOTTOM EDGE OF THE REFLECTING SURFACE 35 INCHES MAXIMUM ABOVE THE FINISH FLOOR OR GROUND.
- COAT HOOKS SHALL BE LOCATED WITHIN ONE OF THE REACH RANGES. SHELVES SHALL BE LOCATED 40 INCHES MINIMUM AND 48 INCHES MAXIMUM ABOVE THE FINISHED FLOOR.
- ACCESSORIES, WHERE TOWEL OR SANITARY NAPKIN DISPENSERS, WASTE RECEPTACLES, OR OTHER ACCESSORIES ARE PROVIDED IN TOILET FACILITIES, AT LEAST ONE OF EACH TYPE SHALL BE LOCATED ON AN ACCESSIBLE ROUTE, ALL OPERABLE PARTS, INCLUDING COIN SLOTS, SHALL BE 40 INCHES MAXIMUM ABOVE THE FINISH FLOOR.

**WATER CLOSETS AND TOILET COMPARTMENTS**

- OVERLAP: THE REQUIRED CLEARANCES AROUND THE WATER CLOSET SHALL BE PERMITTED TO OVERLAP THE WATER CLOSET, ASSOCIATED GRAB BARS, DISPENSERS, SANITARY NAPKIN DISPOSAL UNITS, COAT HOOKS, SHELVES, ACCESSIBLE ROUTES, CLEAR FLOOR SPACE AND CLEARANCES REQUIRED AT OTHER FIXTURE, AND THE TURNING SPACE. NO OTHER FIXTURES OR OBSTRUCTIONS SHALL BE LOCATED WITHIN THE REQUIRED WATER CLOSET CLEARANCE.

**FLUSH VALVES**


- FLUSH CONTROLS SHALL BE HAND OPERATED OR AUTOMATIC, HAND OPERATED FLUSH CONTROLS SHALL COMPLY WITH REACH RANGES EXCEPT THEY SHALL BE LOCATED 44 INCHES MAXIMUM ABOVE THE FLOOR, AND NOT REQUIRE TIGHT GRASPING, PINCHING, OR TWISTING OF THE WRIST. THE FORCE REQUIRED TO ACTIVATE OPERABLE PARTS SHALL BE 5 POUNDS MAXIMUM. FLUSH CONTROLS SHALL BE LOCATED ON THE OPEN SIDE OF THE WATER CLOSET EXCEPT IN AMBULATORY ACCESSIBLE COMPARTMENTS.

**DISPENSERS**

- DISPENSERS SHALL NOT BE OF A TYPE THAT CONTROLS DELIVERY OR THAT DOES NOT ALLOW CONTINUOUS PAPER FLOW.

**AMBULATORY COMPARTMENTS**

- WHERE TOILET COMPARTMENTS ARE PROVIDED AT LEAST ONE SHALL BE ACCESSIBLE. IN ADDITION AT LEAST ONE AMBULATORY COMPARTMENT ARE PROVIDED WHERE SIX OR MORE TOILET COMPARTMENTS ARE PROVIDED, OR WHERE THE COMBINATION OF URINALS AND WATER CLOSETS TOTALS SIX OR MORE FIXTURES.

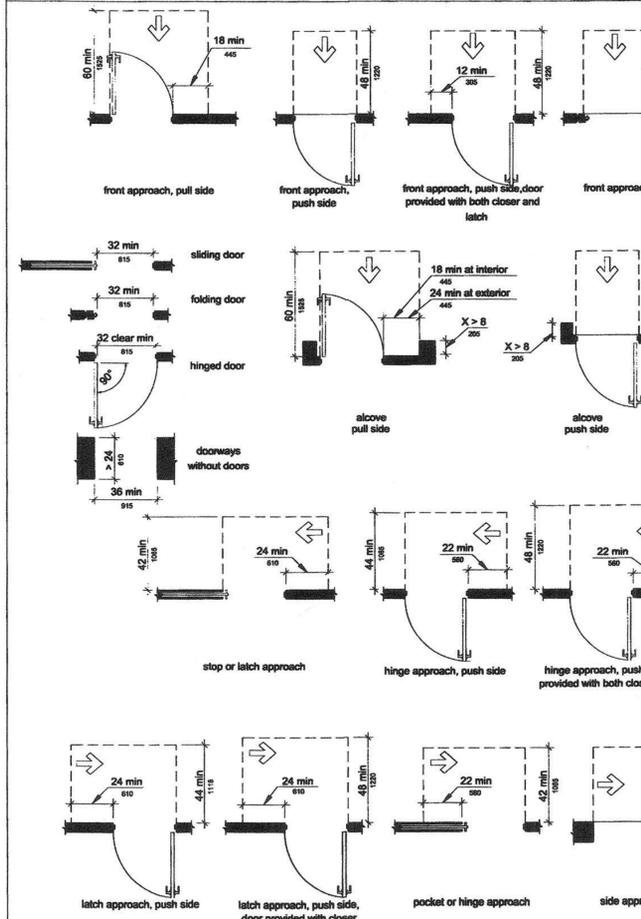

**NOTES:**

- AT LEAST ONE OF THE ACTIVE LEAVES OF DOORWAYS WITH TWO LEAVES SHALL COMPLY WITH PROJECTIONS. THERE SHALL BE NO PROJECTIONS INTO THE REQUIRED CLEAR OPENING WIDTH LOWER THAN 34 INCHES ABOVE THE FINISH FLOOR OR GROUND. PROJECTIONS INTO THE CLEAR OPENING WIDTH BETWEEN 34 INCHES AND 80 INCHES ABOVE THE FINISH FLOOR OR GROUND SHALL NOT EXCEED 4 INCHES. EXCEPTION: IN ALTERATIONS, A PROJECTION OF 5/8" MAXIMUM INTO THE REQUIRED CLEAR WIDTH SHALL BE PERMITTED FOR THE LATCH SIDE STOP, DOOR CLOSERS AND DOOR STOPS SHALL BE PERMITTED TO BE 78 INCHES MINIMUM ABOVE THE FINISH FLOOR OR GROUND.
- REQUIRED MANEUVERING SPACE AT DOORS. MANEUVERING CLEARANCES SHALL EXTEND THE FULL WIDTH OF THE DOORWAY AND THE REQUIRED LATCH SIDE OR HINGE SIDE CLEARANCE. THRESHOLDS IF PROVIDED SHALL COMPLY WITH CHANGES IN LEVEL.
- DOOR HARDWARE. HANDLES, PULLS, LATCHES, LOCKS AND OTHER OPERABLE PARTS ON DOOR AND GATES SHALL BE 34" MINIMUM AND 48 INCHES MAXIMUM ABOVE THE FINISHED FLOOR OR GROUND. WHERE SLIDING DOORS ARE IN THE FULLY OPEN POSITION, OPERATING HARDWARE SHALL BE EXPOSED AND USABLE FROM BOTH SIDES. EXCEPTION: EXISTING LOCKS SHALL BE PERMITTED IN ANY LOCATION AT EXISTING GLAZED DOORS WITHOUT STILES, EXISTING OVERHEAD ROLLING DOORS OR GRILLS, AND SIMILAR EXISTING DOORS OR GRILLS THAT ARE DESIGNED WITH LOCKS THAT ARE ACTIVATED AT THE TOP OR BOTTOM RAIL.
- DOOR CLOSERS AND GATE CLOSERS SHALL BE ADJUSTED SO THAT FROM AN OPEN POSITION OF 90 DEGREES, THE TIME REQUIRED TO MOVE THE DOOR TO A POSITION OF 12 DEGREES FROM THE LATCH IS 5 SECONDS MINIMUM.
- SPRING HINGES DOOR AND GATE. SPRING HINGES SHALL BE ADJUSTED SO THAT FROM THE OPEN POSITION OF 70 DEGREES THE DOOR OR GATE SHALL MOVE TO THE CLOSED POSITION IN 1.5 SECONDS.
- DOOR AND GATE OPENING FORCE. FIRE DOORS SHALL HAVE A MINIMUM OPENING FORCE ALLOWABLE BY THE APPROPRIATE ADMINISTRATIVE AUTHORITY. THE FORCE FOR PUSHING OR PULLING OPEN A DOOR OR GATE OTHER THAN A FIRE DOOR SHALL BE 5 POUNDS FOR INTERIOR DOORS, GATES, SLIDING OR FOLDING DOORS.
- DOOR AND GATE SURFACES. SWINGING DOOR AND GATE SURFACES WITHIN 10 INCHES OF THE FINISHED FLOOR OR GROUND MEASURED VERTICALLY SHALL HAVE A SMOOTH SURFACE ON THE PUSH SIDE EXTENDING THE FULL WIDTH OF THE DOOR OR GATE. PARTS CREATING HORIZONTAL VERTICAL JOINTS IN THESE SURFACES SHALL BE WITHIN 1/16 INCH OF THE SAME PLANE AS THE OTHER. CAVITIES CREATED BY ADDED KICK PLATES SHALL BE CAPPED. EXCEPTIONS: SLIDING DOORS ARE NOT REQUIRED TO COMPLY. TEMPERED GLASS DOORS WITHOUT STILES AND HAVING A BOTTOM RAIL OR SHOE WITH THE TOP LEADING EDGE TAPERED AT 60 DEGREES MINIMUM FROM THE HORIZONTAL SHALL NOT BE REQUIRED TO COMPLY. DOORS AND GATES THAT DO NOT EXTEND TO WITHIN 10 INCHES OF THE FINISH FLOOR OR GROUND SHALL NOT BE REQUIRED TO COMPLY. EXISTING DOORS AND GATED WITHOUT SMOOTH SURFACES WITHIN 10 INCHES OF THE FINISH FLOOR OR GROUND SHALL NOT BE REQUIRED TO PROVIDE A SMOOTH SURFACES PROVIDED THAT IF ADDED KICK PLATED ARE INSTALLED CAVITIES CREATED BY SUCH KICK PLATED ARE CAPPED.
- VISION LIGHTS. DOORS, GATES AND SIDE LIGHTS ADJACENT TO DOORS OR GATES, CONTAINING ONE OR MORE GLAZING PANELS THAT PERMIT VIEWING THROUGH THE PANELS SHALL HAVE THE BOTTOM OF AT LEAST ONE GLAZED PANEL LOCATED 43 INCHES MAXIMUM ABOVE THE FINISH FLOOR. EXCEPTION: VISION LIGHTS WITH THE LOWEST PART MORE THAN 66 INCHES FROM THE FINISH FLOOR OR GROUND SHALL NOT BE REQUIRED TO COMPLY.
- AUTOMATIC AND POWER ASSISTED DOORS AND GATES. AUTOMATIC DOORS AND AUTOMATIC GATES SHALL COMPLY WITH ANSI/BHMA A156.19. LOW ENERGY AND POWER ASSISTED DOORS SHALL COMPLY WITH ANSI/BHMA A156.19. AUTOMATIC DOORS SHALL PROVIDE A CLEAR OPENING OF 32 INCHES MINIMUM IN POWER-ON AND POWER-OFF MODE. THE MINIMUM CLEAR WIDTH OF AUTOMATIC DOOR SYSTEMS IN A DOORWAY SHALL PROVIDE A CLEAR, UNOBSTRUCTED OPENING OF 32 INCHES WITH ONE LEAF POSITIONED AT AN ANGLE OF 90 DEGREES FROM ITS CLOSED POSITION. MANEUVERING CLEARANCES AND THRESHOLDS AT POWER ASSISTED AND AUTOMATIC DOORS SHALL COMPLY. EXCEPTION: WHERE AUTOMATIC DOORS AND GATES REMAIN OPEN IN THE POWER-OFF CONDITION, MANEUVERING CLEARANCES ARE NOT REQUIRED. MANUAL CONTROLS SHALL COMPLY WITH REACH RANGES AND BE LOCATED BEYOND THE ARC OF THE DOOR SWING. WHERE DOORS AND GATES WITHOUT STANDBY POWER ARE A PART OF A MEANS OF EGRESS, THE CLEAR BREAK OUT OPENING AT SWINGING OR SLIDING DOORS AND GATES SHALL BE 32 INCHES MINIMUM WHEN OPERATED IN EMERGENCY MODE.

**NOTES:**



- WHERE ONE OR MORE URINAL ARE PROVIDED, AT LEAST ONE SHALL BE ACCESSIBLE.
- A CLEAR FLOOR OR GROUND SPACE POSITIONED FOR FORWARD APPROACH SHALL BE PROVIDED.
- FLUSH CONTROLS SHALL BE HAND OPERATED OR AUTOMATIC, HAND OPERATED FLUSH CONTROLS SHALL COMPLY WITH REACH RANGES AND NOT REQUIRE TIGHT GRASPING, PINCHING, OR TWISTING OF THE WRIST. THE FORCE REQUIRED TO ACTIVATE OPERABLE PARTS SHALL BE 5 POUNDS MAXIMUM. HAND OPERATED FLUSH CONTROLS SHALL BE MOUNTED AT A MAXIMUM HEIGHT OF 44 INCHES ABOVE THE FINISH FLOOR.

**SCOPE:**

NO FEWER THAN TWO DRINKING FOUNTAINS SHALL BE PROVIDED, ONE ACCESSIBLE AND ONE FOR STANDING. WHERE A SINGLE DRINKING FOUNTAIN COMPLYING WITH BOTH IS SHOWN, IT SHALL BE PERMITTED TO BE SUBSTITUTED FOR TWO SEPARATE DRINKING FOUNTAINS.

**NOTES:**

- A CLEAR FLOOR SPACE POSITIONED FOR A FORWARD APPROACH SHALL BE PROVIDED. PROVIDE KNEE AND TOE SPACE. THE CLEAR SPACE SHALL BE CENTERED ON THE DRINKING FOUNTAIN.
- OPERABLE PARTS SHALL COMPLY WITH OPERABLE PARTS REQUIREMENTS. THE FLOW OF WATER SHALL BE ACTIVATED BY A MANUALLY OPERATED SYSTEM THAT IS FROM MOUNTED OR SIDE MOUNTED AND LOCATED WITHIN 6 INCHES OF THE FRONT EDGE OF THE FOUNTAIN OR AN AUTOMATIC ELECTRONICALLY CONTROLLED DEVICE.
- SPOUT OUTLETS OF WHEELCHAIR ACCESSIBLE DRINKING FOUNTAINS SHALL BE 36 INCHES MAXIMUM ABOVE THE FLOOR. SPOUT OUTLETS OF DRINKING FOUNTAINS FOR STANDING PERSONS SHALL BE 38 INCHES MINIMUM AND 43 INCHES MAXIMUM ABOVE THE FLOOR.
- THE SPOUT SHALL PROVIDE A FLOW OF WATER 4 INCHES MINIMUM IN HEIGHT. THE ANGLE OF THE WATER STREAM FROM THE SPOUTS WITHIN 3 INCHES OF THE FRONT OF THE DRINKING FOUNTAIN SHALL BE 30 DEGREES MAXIMUM, AND FROM SPOUTS BETWEEN 3 INCHES AND 5 INCHES FROM THE FRONT OF THE DRINKING FOUNTAIN SHALL BE 15 DEGREES MAXIMUM, MEASURED HORIZONTALLY RELATIVE TO THE FRONT FACE OF THE DRINKING FOUNTAIN.
- DEPTH, WALL AND POST-MOUNTED CANTILEVERED DRINKING FOUNTAINS SHALL BE 18 INCHES MINIMUM AND 19 INCHES MAXIMUM IN DEPTH.
- PEDESTRIAN PROTECTION. ALL DRINKING FOUNTAINS SHALL EITHER BE LOCATED COMPLETELY WITHIN ALCOVES OR BE POSITIONED BETWEEN WING WALLS, OR OTHERWISE POSITIONED SO AS NOT TO ENCRUSH INTO PEDESTRIAN WAYS. THE PROTECTED AREA WITHIN WHICH A DRINKING FOUNTAIN IS LOCATED SHALL BE 32 INCHES WIDE MINIMUM AND 18 INCHES DEEP MINIMUM, AND SHALL COMPLY WITH MANEUVERING CLEARANCES FOR ALCOVES. WHEN USED, WING WALLS OR BARRIERS SHALL PROJECT HORIZONTALLY AT LEAST AS FAR AS THE DRINKING FOUNTAIN AND TO WITHIN 6 INCHES VERTICALLY FORM THE FLOOR OR GROUND SURFACE.



PLAN CHECK # :  
PERMIT # :  
ADDRESS:

2013 California Building Code  
Accessibility Cover Sheet

CITY OF  
**VENTURA**  
www.cityofventura.net

