
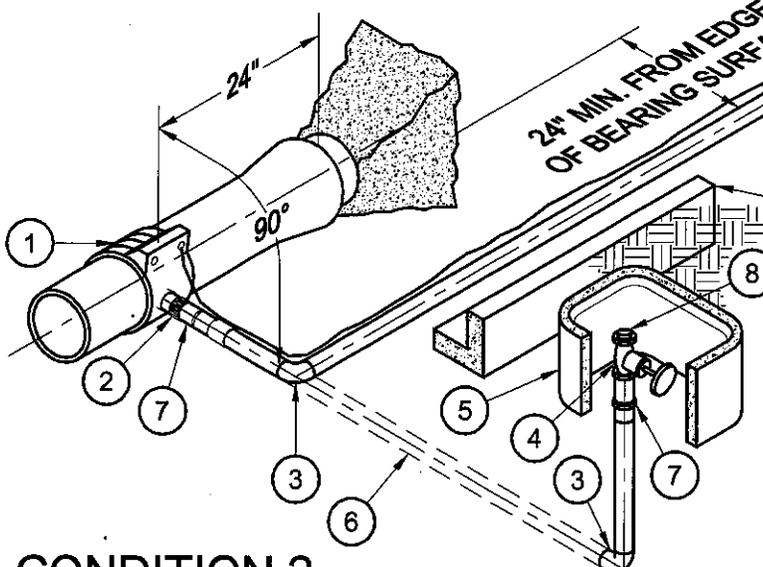


CONDITION 1 CUL-DE-SAC OR END OF ROAD

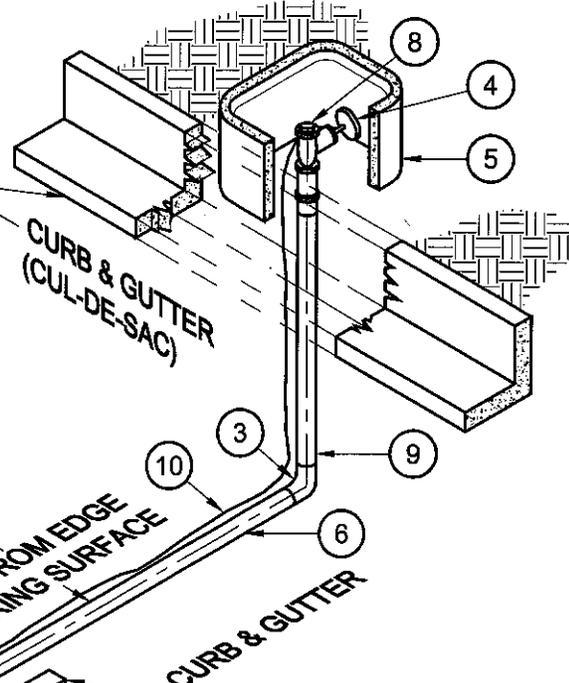

NOTES

1. SEE CITY STANDARD DETAIL 001 - GENERAL WATER NOTES
2. ALL LOCATIONS AND DIMENSIONS GIVEN SHALL BE AS SHOWN UNLESS OTHERWISE SPECIFIED BY THE CITY.
3. ALL MATERIALS SPECIFIED ON THIS STANDARD SHALL BE AS SHOWN OR AN APPROVED EQUAL AUTHORIZED BY THE CITY ENGINEER IN WRITING.
4. ALL FITTINGS SHALL BE BRAZE FITTINGS EXCEPT AS NOTED AND SHALL CONFORM TO AB 1953.
5. ALL DEAD ENDS SHALL HAVE A BLOW OFF.

CONDITION 2 INSTALLATION PERPENDICULAR TO WATER MAIN

LEGEND

- | | |
|---|--|
| <p>① SERVICE SADDLE DOUBLE STRAP, INSTALLED PER MANUFACTURER'S RECOMENDATIONS: FORD 202B SERIES (DIP, ACP) FORD 202BS SERIES (PVC), ROMAC 202N-H SERIES (HDPE).</p> <p>② 2" CORPORATION STOP W/ STAINLESS STEEL INSERTS: FORD 1100-7Q-NL-CTS</p> <p>③ 90° BRASS COMP X COMP, FORD L4477QL.</p> <p>④ BALL VALVE CURB STOP AND STAINLESS STEEL INSERTS: FORD B11-777-NL</p> | <p>⑤ METER BOX ARMORCAST OR CHRISTY FL12T FIBRELYTE BOX 12"x20"</p> <p>⑥ 2" Ø HDPE PIPE. (CTS).</p> <p>⑦ USE COMPRESSION FITTING WITH STAINLESS STEEL INSERTS TO CONNECT TO 2" Ø HDPE.</p> <p>⑧ 2" BRASS PLUG OR AS APPROVED BY CITY ENGINEER.</p> <p>⑨ 2" Ø TYPE "K" COPPER RISER.</p> <p>⑩ LOCATING WIRE PER NOTE I, DETAIL 009.</p> |
|---|--|

CITY OF SAN BUENAVENTURA

PUBLIC WORKS DEPARTMENT
ENGINEERING DIVISION

2" BLOW OFF ASSEMBLY

STD. DET. NO.
015

APPROVED BY: WATER GENERAL MANAGER

APPROVED BY: CITY ENGINEER R.C.E. 37064

DATE 7-7-16

SHEET
1 of 1