


RED OXIDE PRIMER PIPES & PAINT CHROME YELLOW PER STANDARD DETAIL 020, NOTE 5

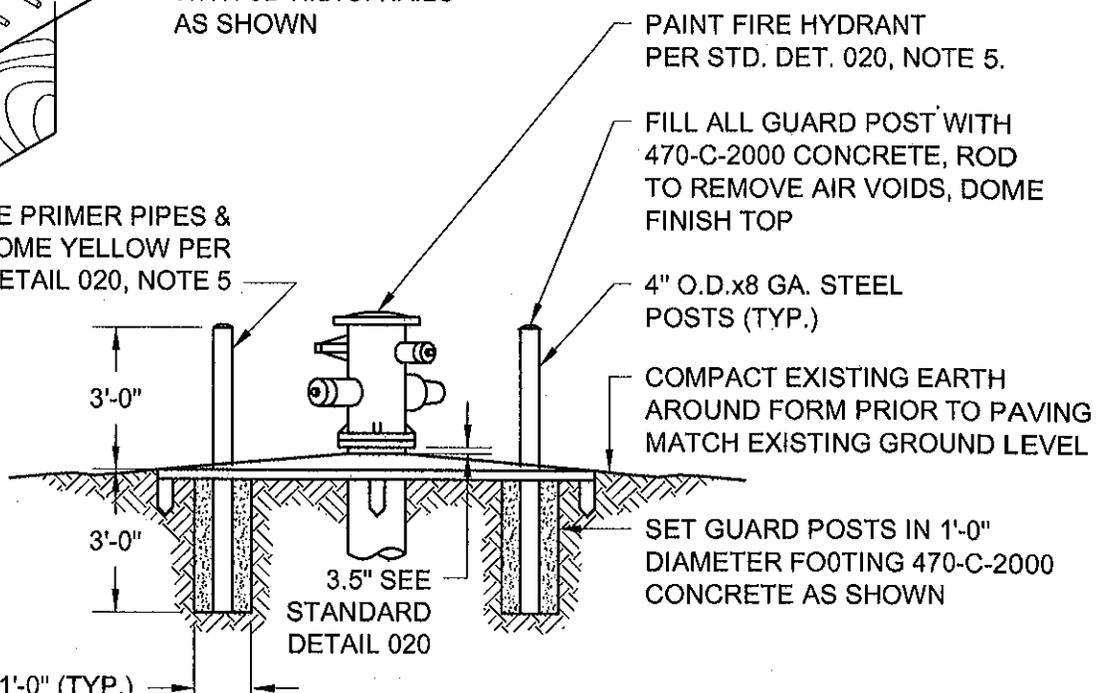

NOTES

1. FILL REDWOOD FORM WITH 3/4" MINUS UNTREATED ROCK BASE TO WITHIN 1" OF THE FORM TOP AND COMPACT. PAVE WITH HOT ASPHALTIC CONCRETE. USE A 1" LIFT AT FORM EDGES TO 2" LIFT AT CENTER OF PAD. HAND FINISH WITH VIBRATORY PLATE HOLDING DRAIN SLOPES OF 1/4" TO 1" TO EDGES OF FORM.
2. UNLESS OTHERWISE NOTED FIRE HYDRANT INSTALLATION SHALL CONFORM TO CITY STANDARD.

CITY OF SAN BUENAVENTURA

PUBLIC WORKS DEPARTMENT
ENGINEERING DIVISION

FIRE HYDRANT IN UNIMPROVED AREAS

STD. DET. NO.
022

APPROVED BY: *[Signature]*
WATER MANAGER

APPROVED BY: *[Signature]*
CITY ENGINEER R.C.E. 37064

DATE *10-31-12*

SHEET
1 of 1